

Baseboard System (Three Way Zone Valve Controlled)


NOTE

Outdoor furnace water temperature setpoint should be set at 185°F minimum.

This horizontal assembly must not exceed a height of 4 inches above top of water heater.

NOTE

A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

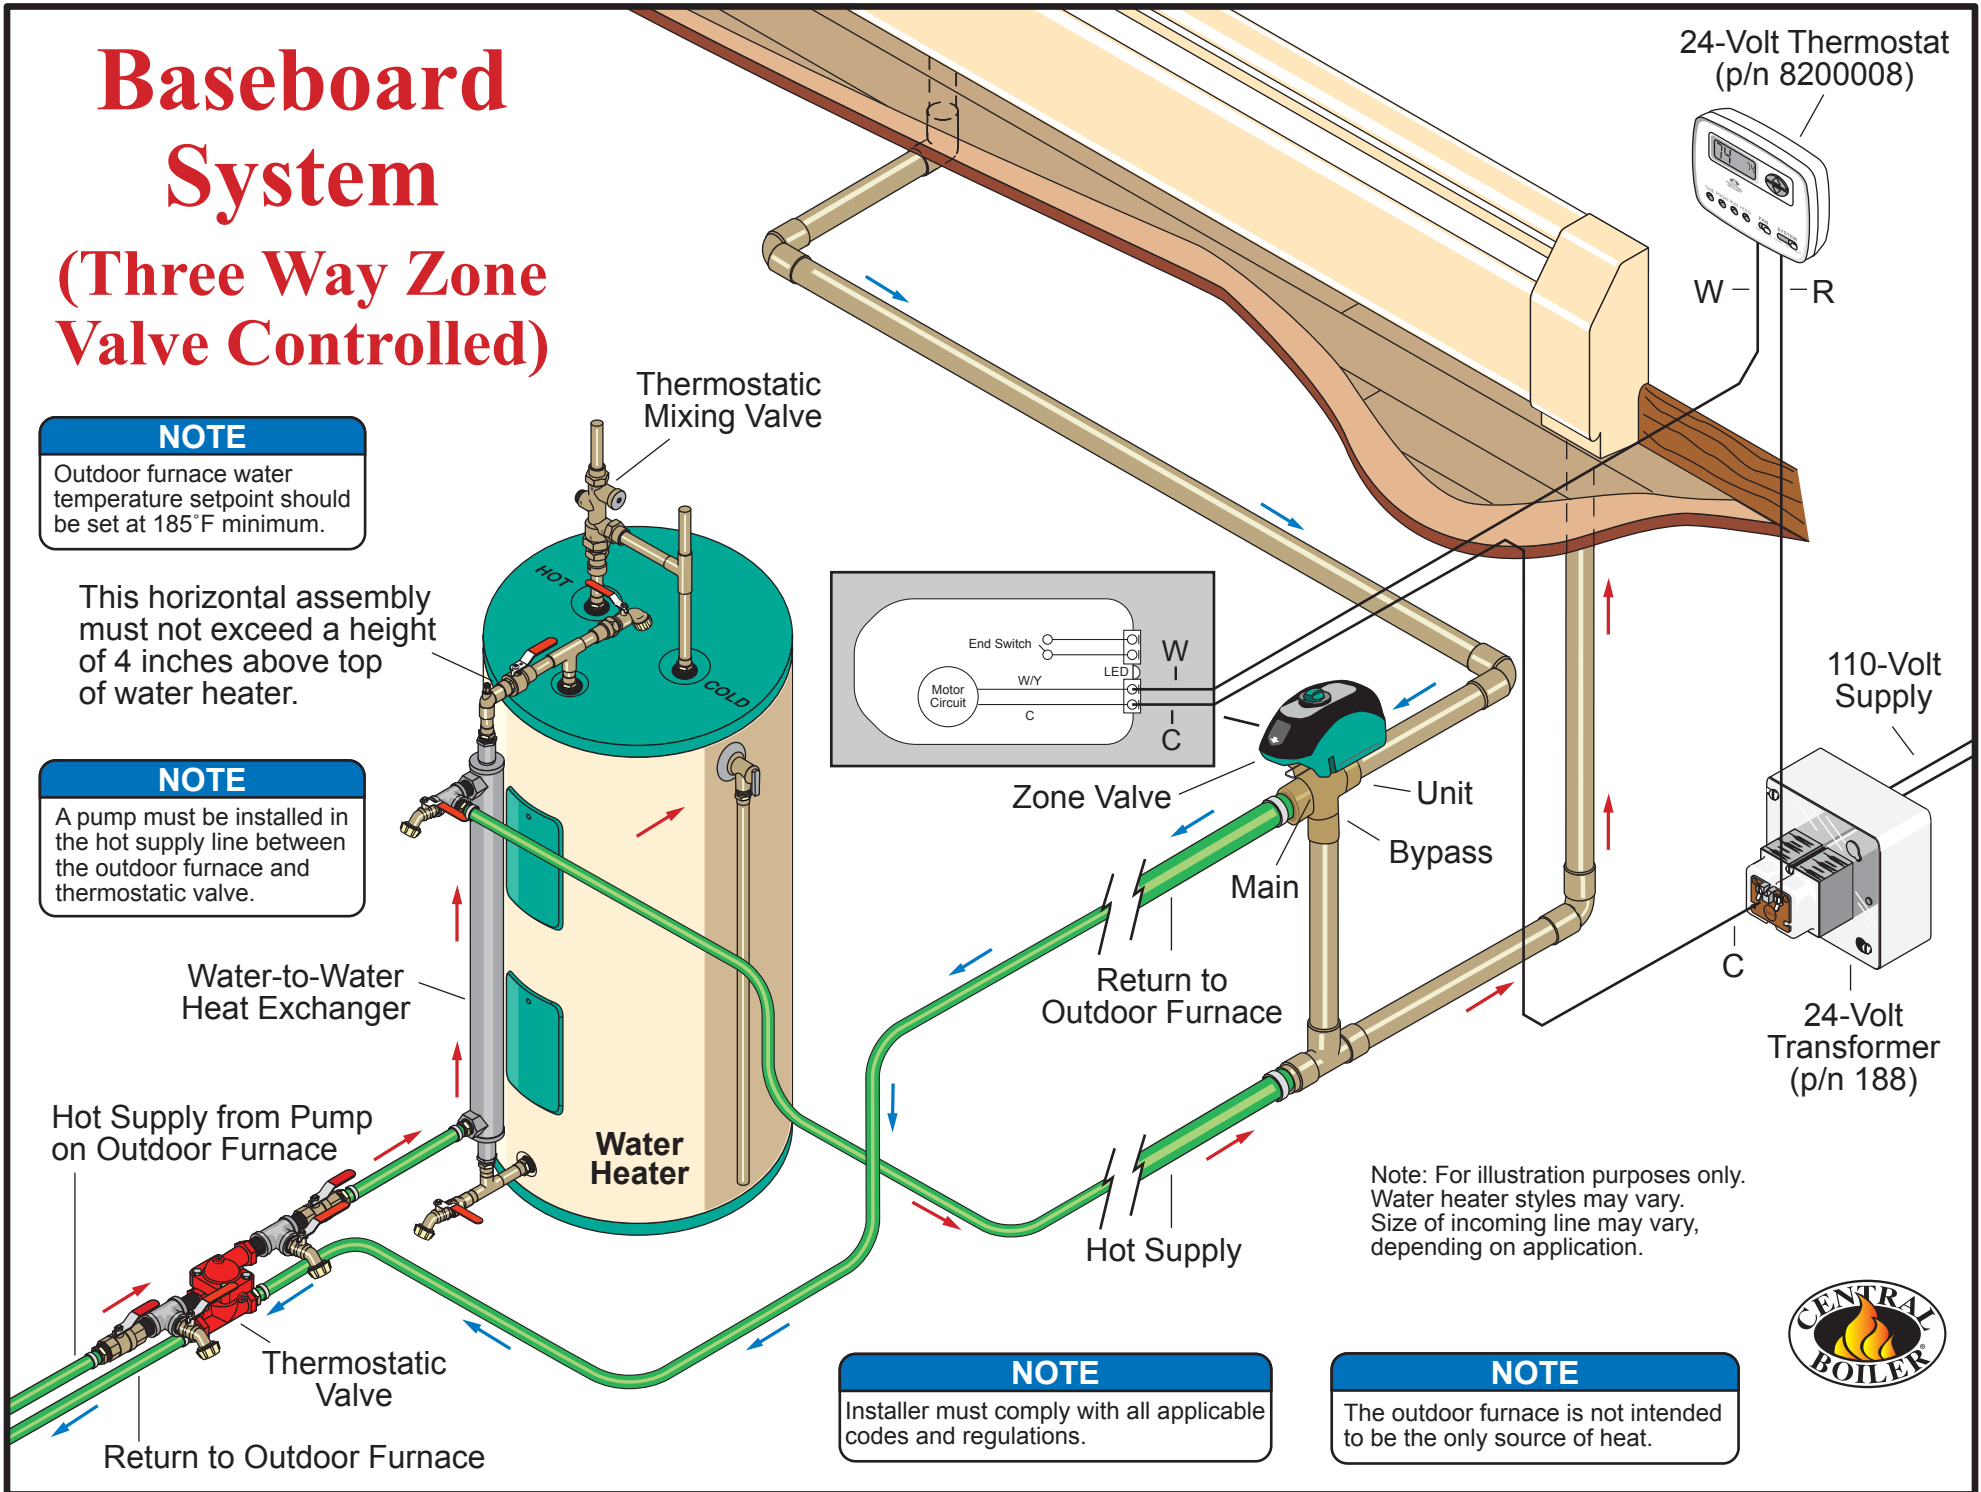

Note: For illustration purposes only. Water heater styles may vary. Size of incoming line may vary, depending on application.

NOTE

Installer must comply with all applicable codes and regulations.

NOTE

The outdoor furnace is not intended to be the only source of heat.

